


NOTES:

1. INSIDE DROPS ALLOWED ONLY UNDER CIRCUMSTANCES WHERE OUTSIDE DROPS ARE IMPOSSIBLE DUE TO EXISTING UTILITIES OR OTHER CONFLICTS AS APPROVED BY THE DIRECTOR OF ENGINEERING.
2. MANHOLE TO BE BUILT IN ACCORDANCE WITH TOWN STANDARD DETAILS, 5' DIAMETER OR GREATER MANHOLES.
3. TEE AND 90 DEGREE BENDS CONNECTED TO PIPE WITH MEGA-LUG TYPE RIGID RESTRAINTS
4. PIPE SIZE NOT TO EXCEED 24"
5. PIPE TYPE PER ACCEPTABLE DESIGN OF SDR 26 OR D.I.P.

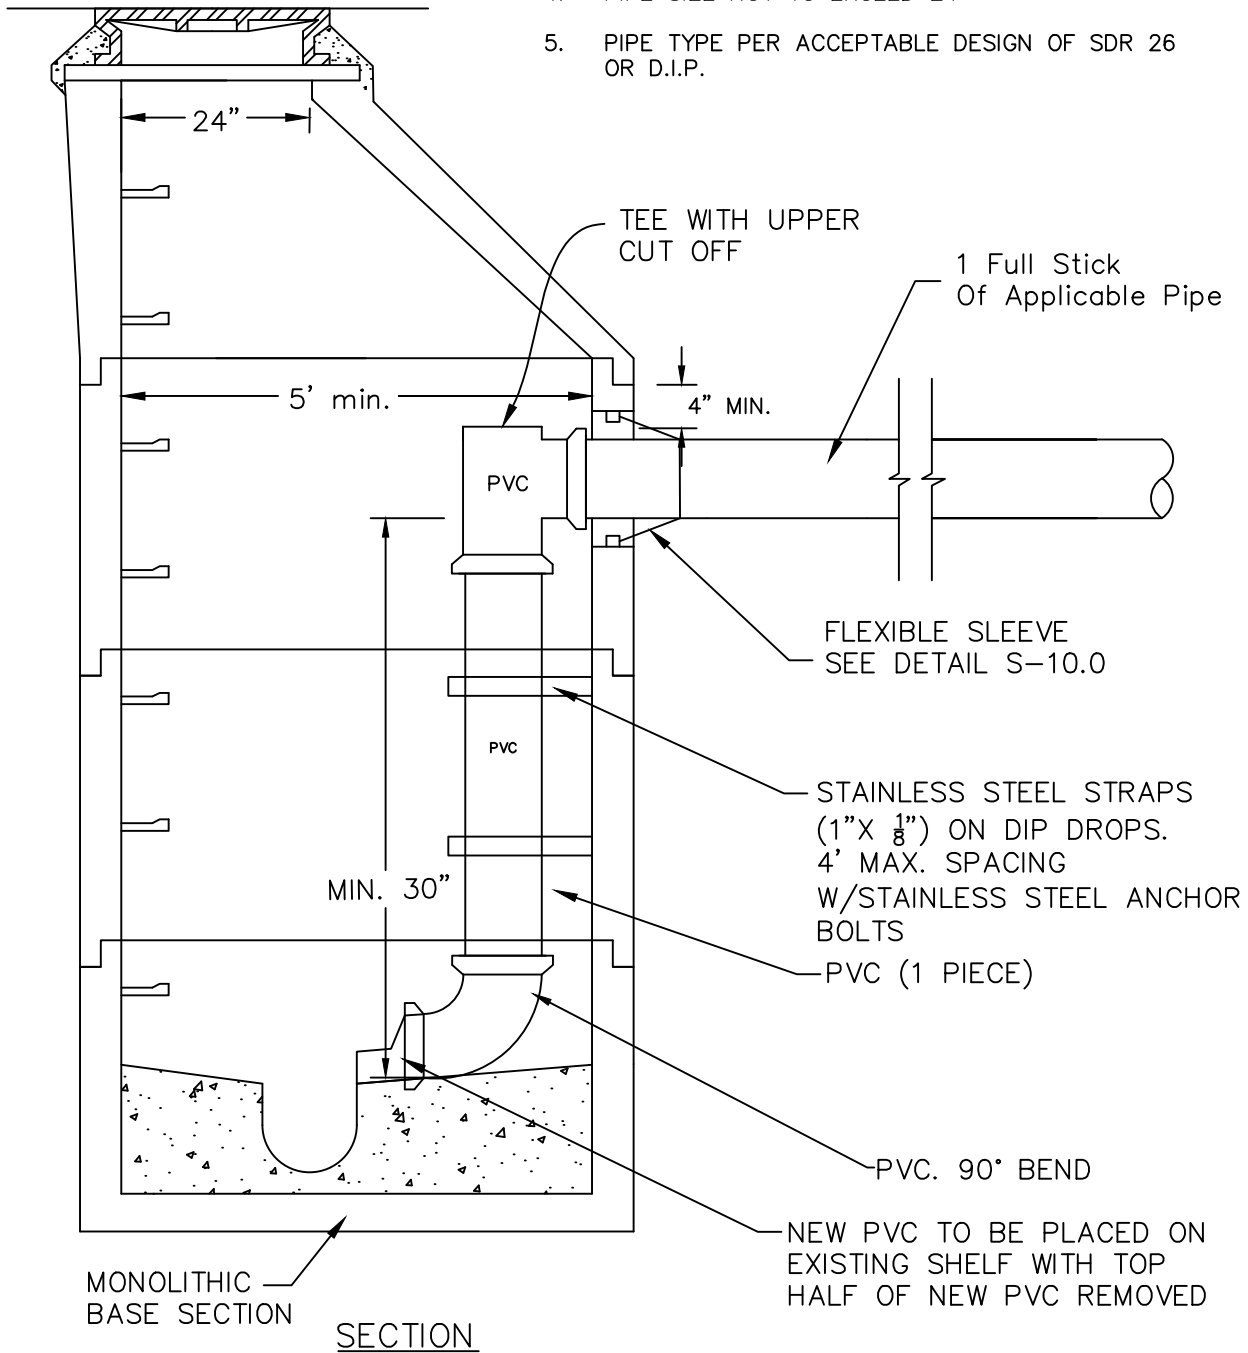

**TOWN OF MOORESVILLE**

STANDARD DETAIL

SEWER SYSTEMS  
**INSIDE DROP  
MANHOLE**

June 2018  
Revision 4

NTS

S-8.0